


FNAME Navy_Vallidng

REVDATE 8/18/05

USER Carl_Hazenberg

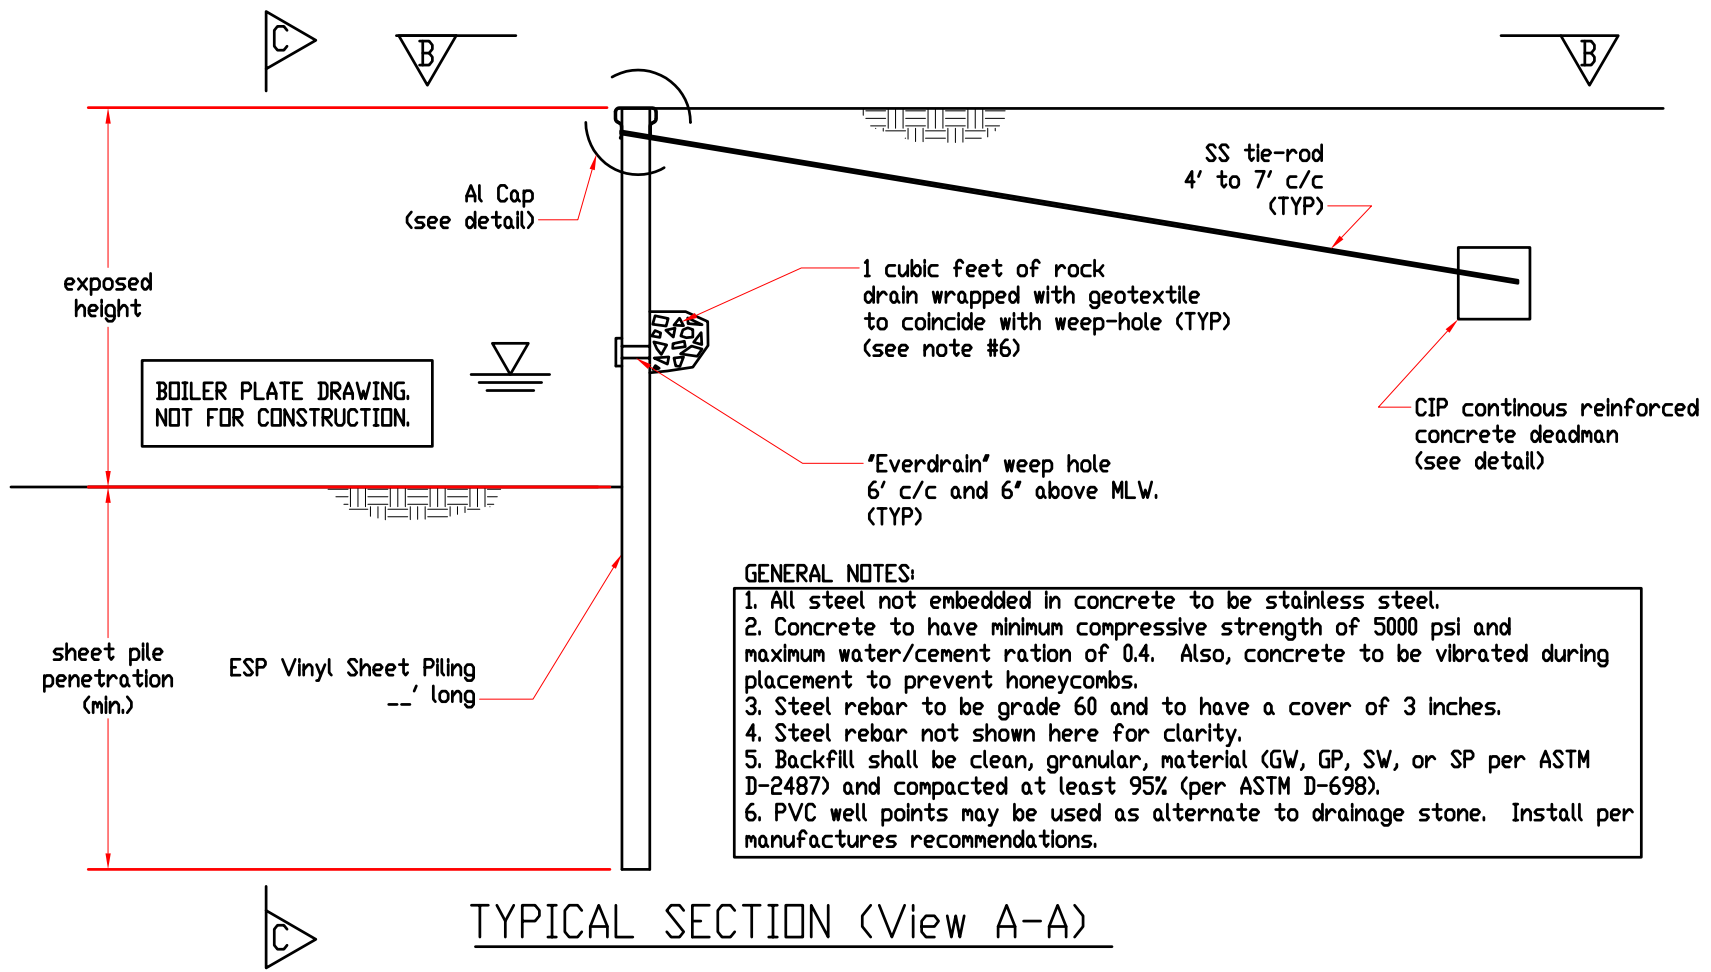

- GENERAL NOTES:**
1. All steel not embedded in concrete to be stainless steel.
 2. Concrete to have minimum compressive strength of 5000 psi and maximum water/cement ration of 0.4. Also, concrete to be vibrated during placement to prevent honeycombs.
 3. Steel rebar to be grade 60 and to have a cover of 3 inches.
 4. Steel rebar not shown here for clarity.
 5. Backfill shall be clean, granular, material (GW, GP, SW, or SP per ASTM D-2487) and compacted at least 95% (per ASTM D-698).
 6. PVC well points may be used as alternate to drainage stone. Install per manufactures recommendations.

TYPICAL SECTION (View A-A)



Scale: NTS

Date: 8/3/05

Everlast Synthetic Products, LLC
 1000 Wyngate Pkwy,S-100
 Woodstock, GA 30189
 (800)687-0036

Project:
 Waterline Development
 12890 Anywhere Street
 Coastline, FL 33705

THIS DRAWING CONTAINS PROPRIETARY INFORMATION, WHICH IS THE PROPERTY OF EVERLAST SYNTHETIC PRODUCTS, LLC AND SHALL NOT BE COPIED, REPRODUCED, OR MADE AVAILABLE TO THIRD PARTIES WITHOUT PRIOR WRITTEN PERMISSION FROM EVERLAST SYNTHETIC PRODUCTS, LLC.

Sheet 1 of 4

BOILER PLATE DRAWING.
 NOT FOR CONSTRUCTION.

Certified only with seal, signature, and date