


FILENAME Navy\_Vallidwg

REVDATE 8/19/05

USER Carl Hazenberg

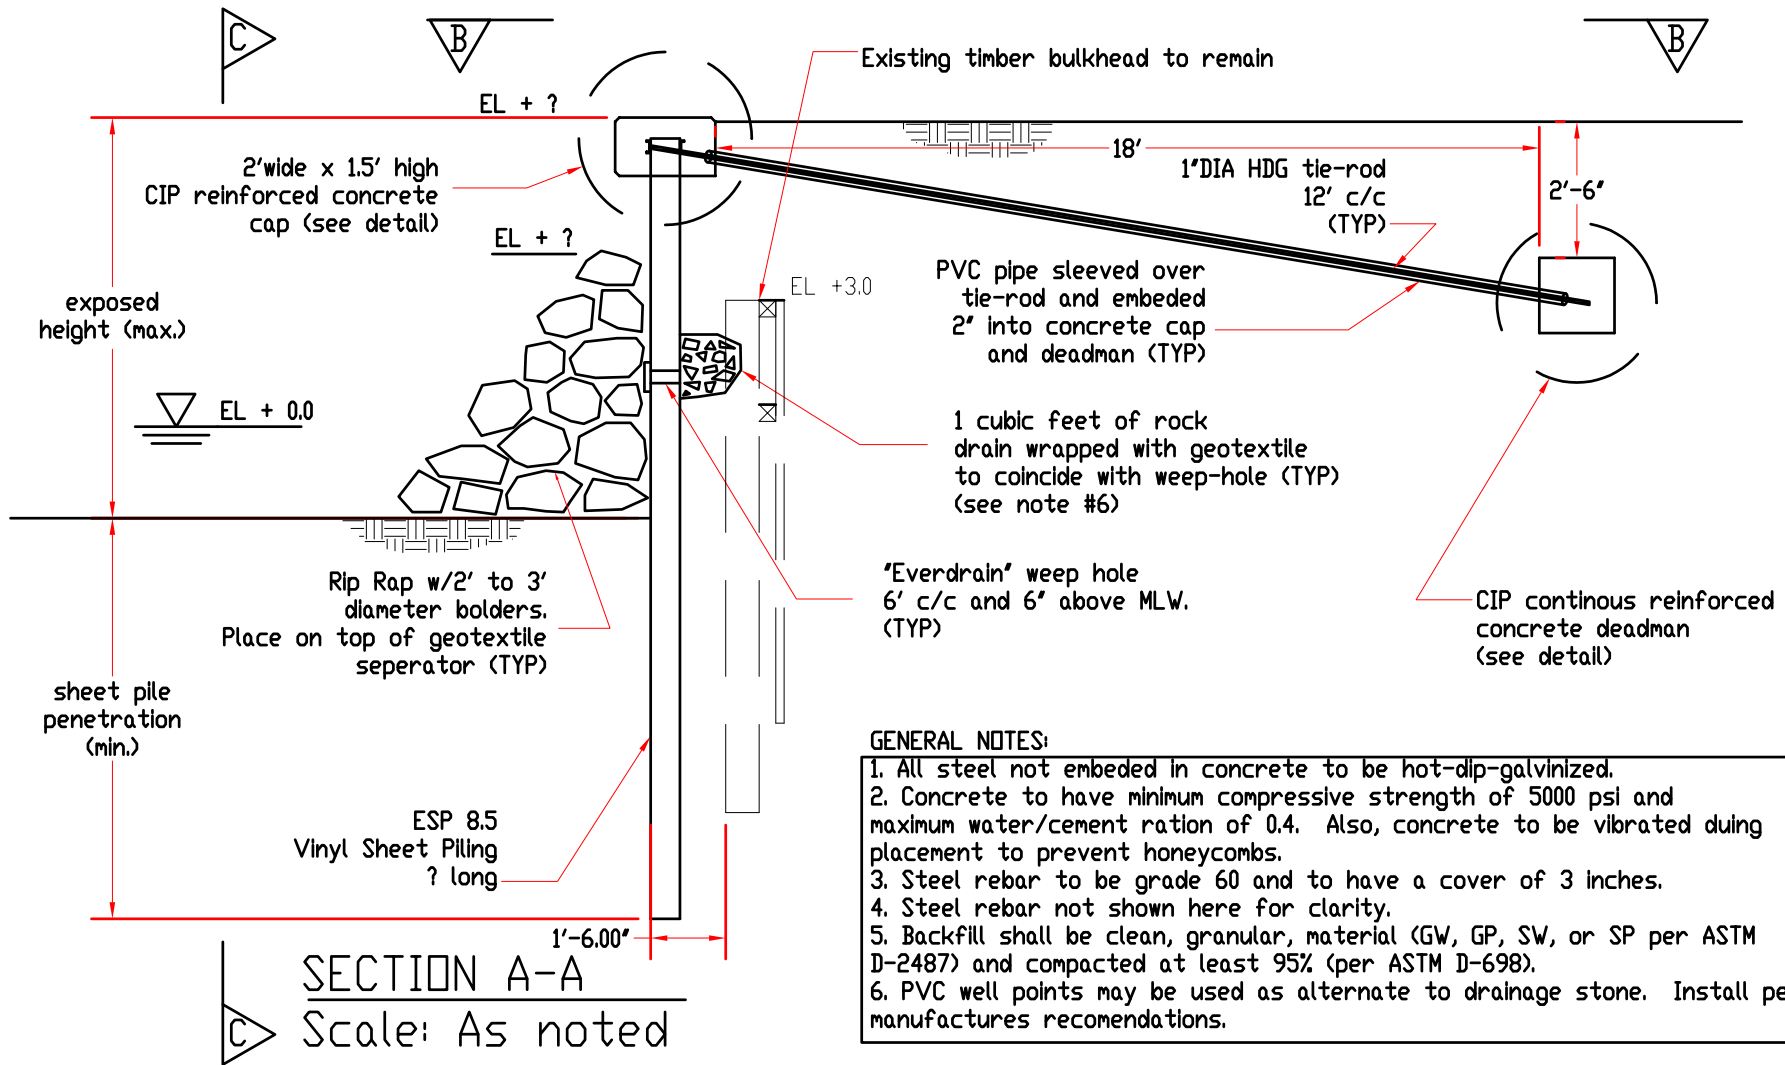

- GENERAL NOTES:**
1. All steel not embedded in concrete to be hot-dip-galvanized.
  2. Concrete to have minimum compressive strength of 5000 psi and maximum water/cement ration of 0.4. Also, concrete to be vibrated during placement to prevent honeycombs.
  3. Steel rebar to be grade 60 and to have a cover of 3 inches.
  4. Steel rebar not shown here for clarity.
  5. Backfill shall be clean, granular, material (GW, GP, SW, or SP per ASTM D-2487) and compacted at least 95% (per ASTM D-698).
  6. PVC well points may be used as alternate to drainage stone. Install per manufactures recomendations.



Everlast Synthetic Products, LLC  
 1000 Wyngate Pkwy, S-100  
 Woodstock, GA 30189  
 (800)687-0036

Scale: NTS

Date: 1/6/06

Project:  
 Waterline Development  
 12890 Anywhere Street  
 Coastline, FL 33705

THIS DRAWING CONTAINS PROPRIETARY INFORMATION, WHICH IS THE PROPERTY OF EVERLAST SYNTHETIC PRODUCTS, LLC AND SHALL NOT BE COPIED, REPRODUCED, OR MADE AVAILABLE TO THIRD PARTIES WITHOUT PRIOR WRITTEN PERMISSION FROM EVERLAST SYNTHETIC PRODUCTS, LLC.

Sheet 1 of 4

BOILER PLATE  
 DRAWING.  
 NOT FOR  
 CONSTRUCTION.

Certified only with seal, signature, and date